


Auftraggeber Maulide
mari-0310

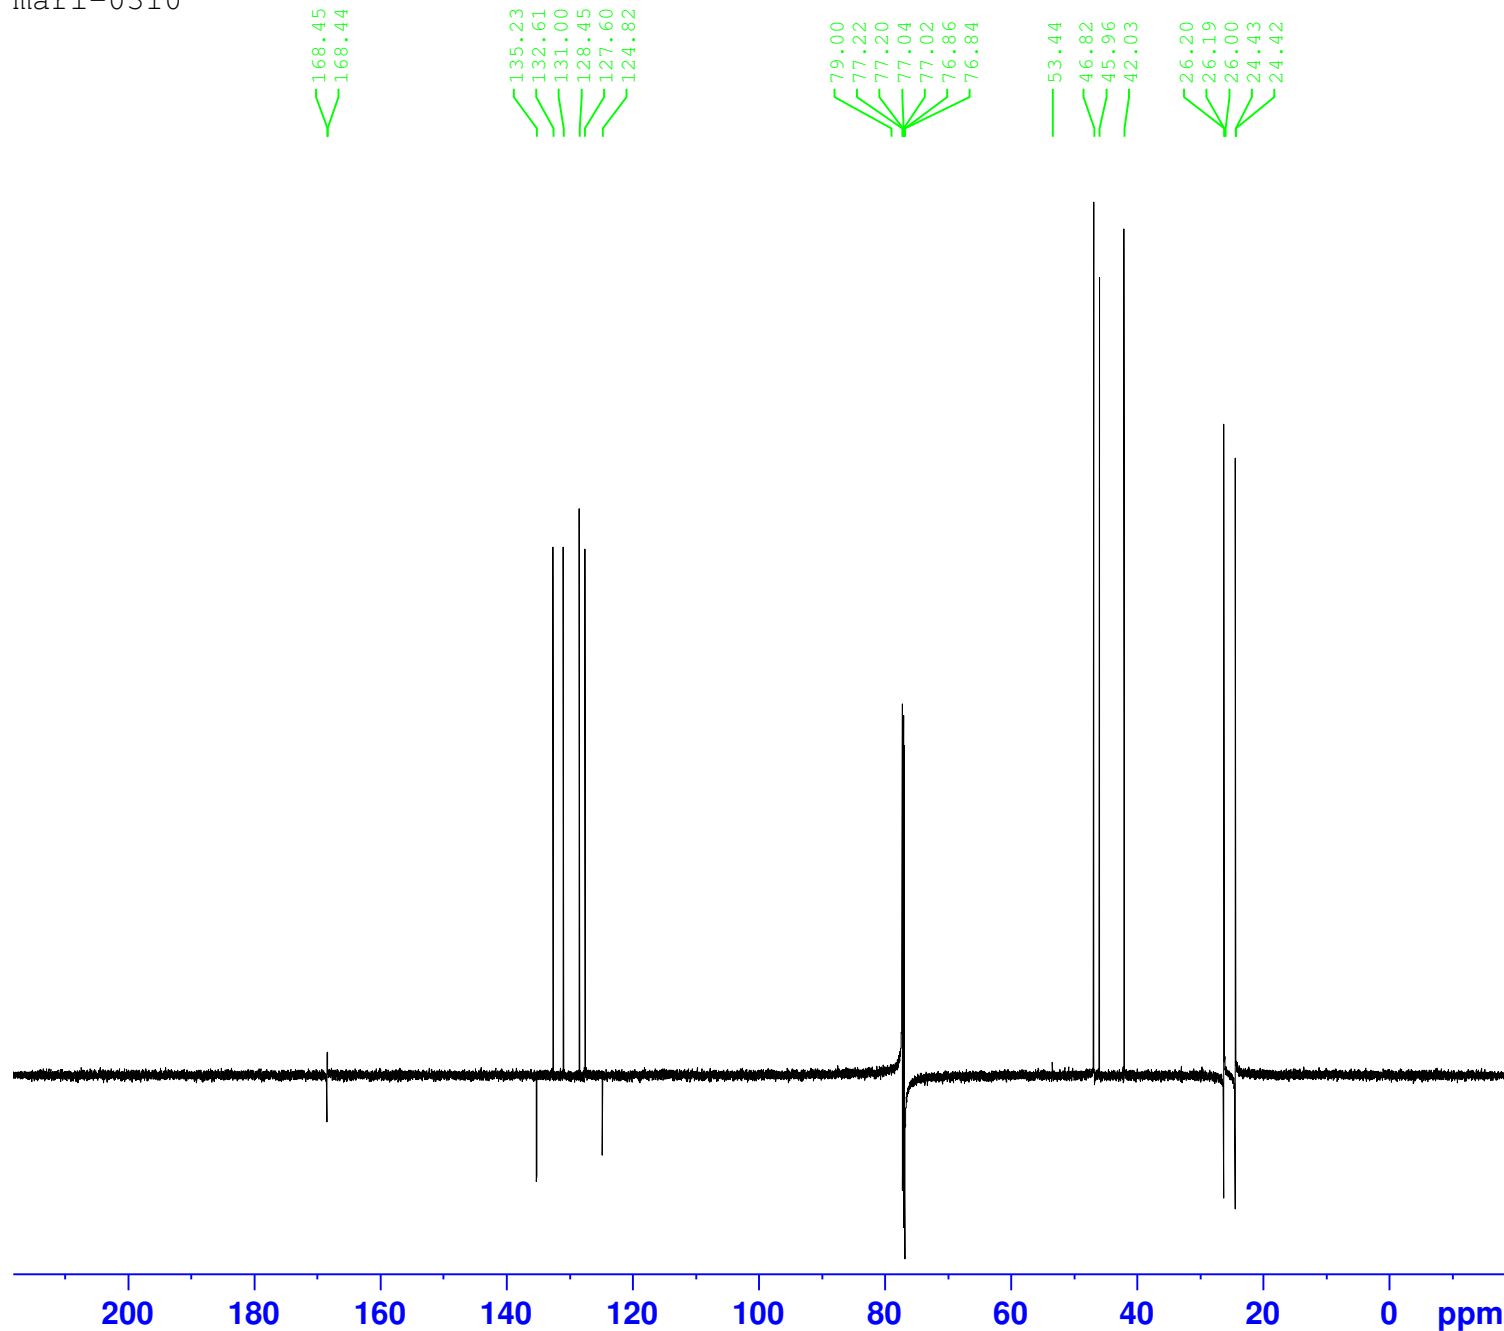

Current Data Parameters
NAME 7Dec1119
EXPNO 111
PROCNO 1

F2 - Acquisition Parameters
Date_ 20191211
Time 13.59 h
INSTRUM spect
PROBHD Z122896_0005 (
PULPROG deptqgppsp
TD 65536
SOLVENT CDC13
NS 150
DS 4
SWH 41666.668 Hz
FIDRES 1.271566 Hz
AQ 0.7864320 sec
RG 175.94
DW 12.000 usec
DE 18.00 usec
TE 298.2 K
CNST2 145.0000000
D1 2.00000000 sec
D2 0.00344828 sec
D12 0.00002000 sec
D16 0.00020000 sec
TD0 1
SFO1 176.1333316 MHz
NUC1 13C
P1 12.00 usec
P13 2000.00 usec
PLW0 0 W
PLW1 160.00000000 W
SPNAM[5] Crp80comp.4
SPOALS 0.500
SPOFFS5 0 Hz
SPW5 46.93700027 W
SFO2 700.4028016 MHz
NUC2 1H
CNST12 1.5000000
CPDPRG[2] waltz16
P0 15.00 usec
P3 10.00 usec
P4 20.00 usec
PCPD2 65.00 usec
PLW2 8.00000000 W
PLW12 0.18934999 W
GPNAM[1] SMSQ10.100
GPZ1 31.00 %
GPNAM[2] SMSQ10.100
GPZ2 31.00 %
GPNAM[3] SMSQ10.100
GPZ3 31.00 %
P16 1000.00 usec

F2 - Processing parameters
SI 131072
SF 176.1157200 MHz
WDW EM
SSB 0
LB 1.00 Hz
GB 0
PC 1.40