


Auftraggeber Maulide  
hazh43 F2

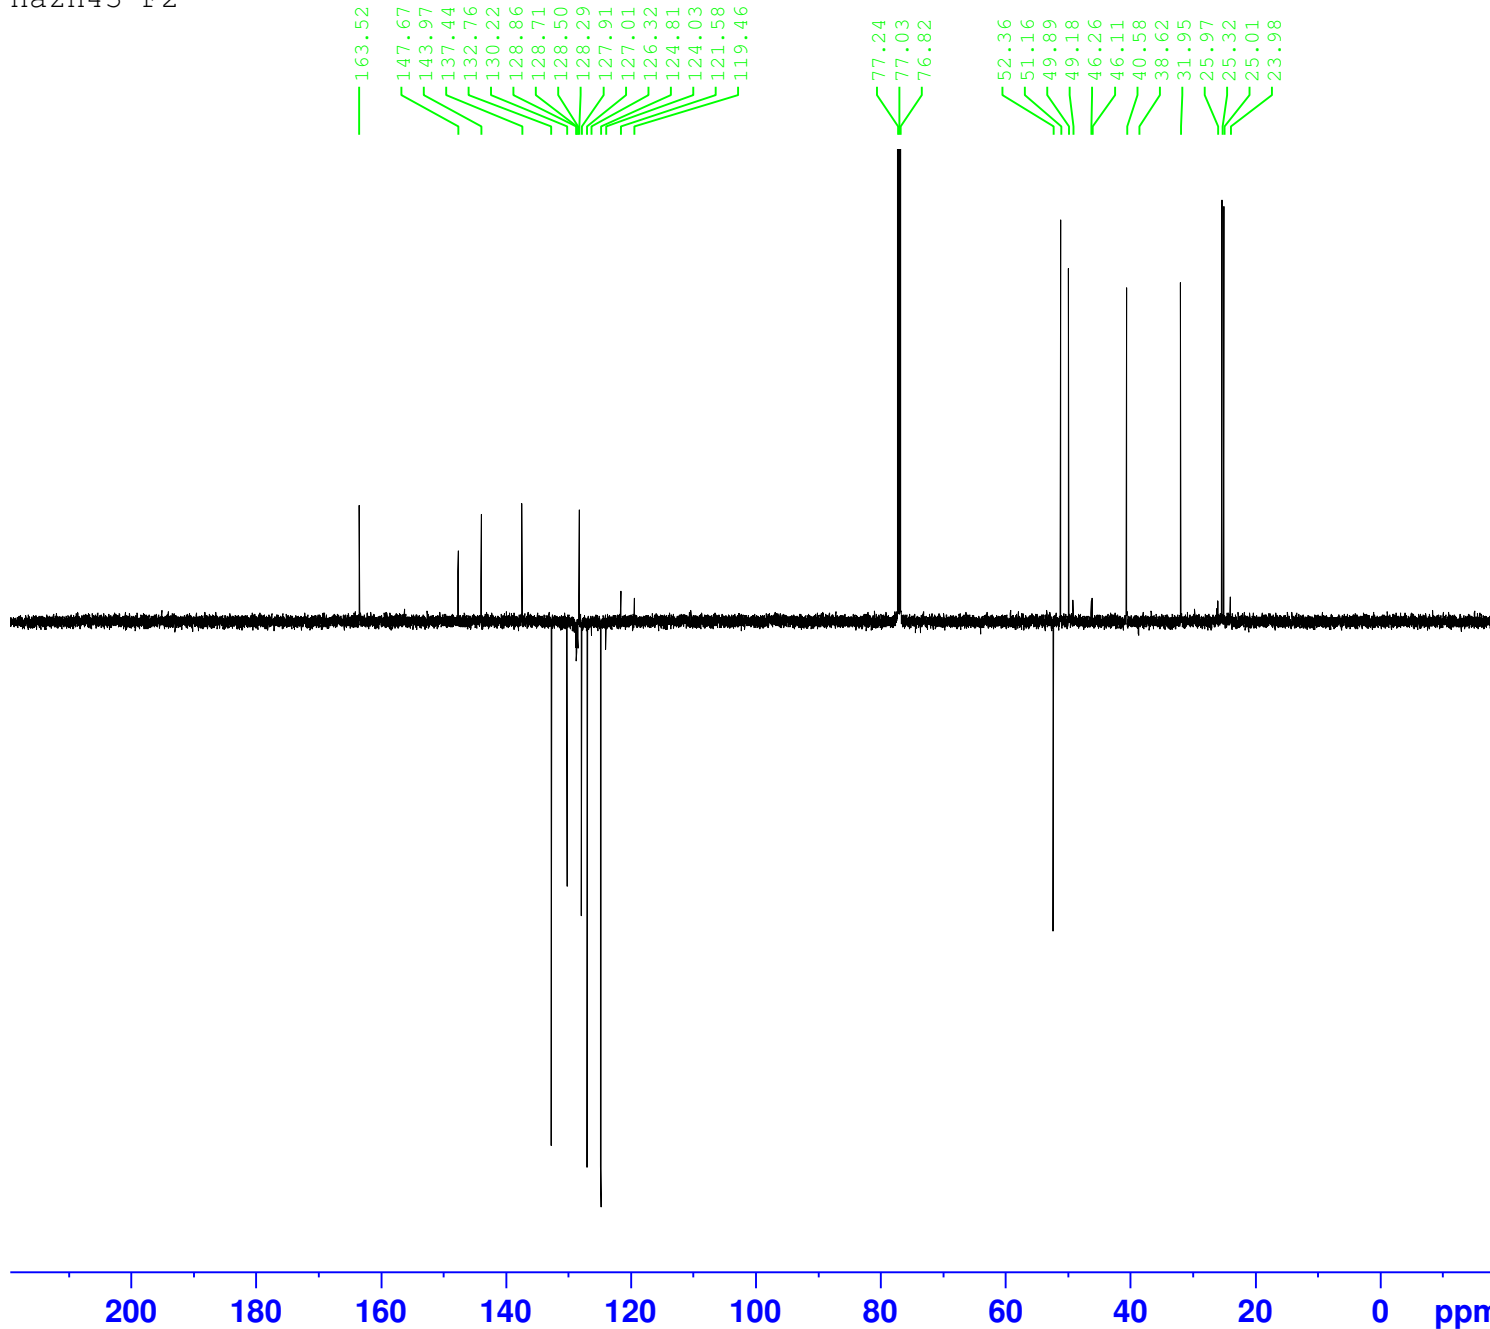

Current Data Parameters  
NAME 6Jul2419  
EXPNO 41  
PROCNO 1

F2 - Acquisition Parameters  
Date\_ 20190724  
Time 11.50 h  
INSTRUM spect  
PROBHD Z126545\_0016 (  
PULPROG deptqgppsp  
TD 65536  
SOLVENT CDC13  
NS 256  
DS 4  
SWH 36057.691 Hz  
FIDRES 1.100393 Hz  
AQ 0.9087659 sec  
RG 1820  
DW 13.867 usec  
DE 18.00 usec  
TE 298.2 K  
CNST2 145.0000000  
D1 2.00000000 sec  
D2 0.00344828 sec  
D12 0.00002000 sec  
D16 0.00020000 sec  
TD0 1  
SFO1 150.9480754 MHz  
NUC1 13C  
P1 10.00 usec  
P13 2000.00 usec  
PLW0 0 W  
PLW1 66.00000000 W  
SPNAM[5] Crp60comp.4  
SPOALS 0.500  
SPOFFS5 0 Hz  
SPW5 10.08399963 W  
SFO2 600.2524010 MHz  
NUC2 1H  
CNST12 1.5000000  
CPDPRG[2] waltz16  
P0 18.38 usec  
P3 12.25 usec  
P4 24.50 usec  
PCPD2 70.00 usec  
PLW2 25.60000038 W  
PLW12 0.78399998 W  
GPNAM[1] SMSQ10.100  
GPZ1 31.00 %  
GPNAM[2] SMSQ10.100  
GPZ2 31.00 %  
GPNAM[3] SMSQ10.100  
GPZ3 31.00 %  
P16 1000.00 usec

F2 - Processing parameters  
SI 131072  
SF 150.9329825 MHz  
WDW EM  
SSB 0  
LB 1.00 Hz  
GB 0  
PC 1.40