
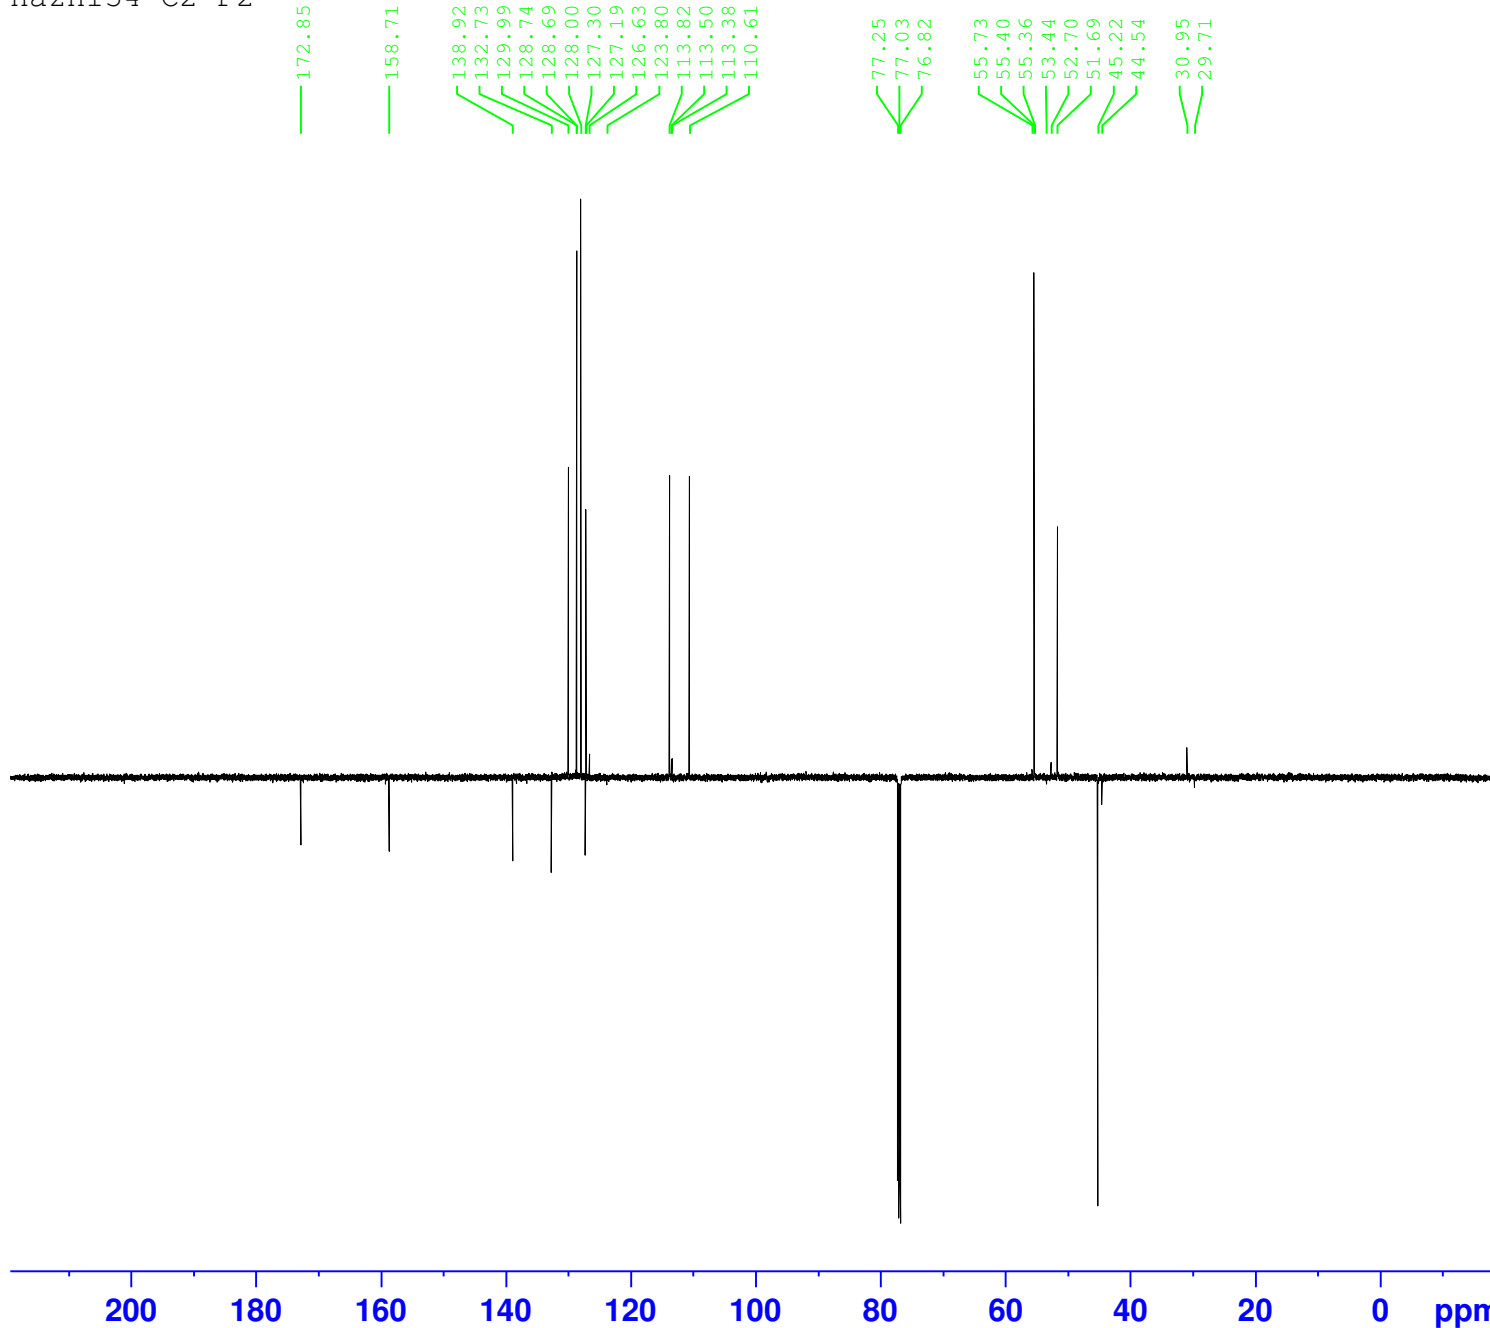


Auftraggeber Maulide
hazh134 C2-F2

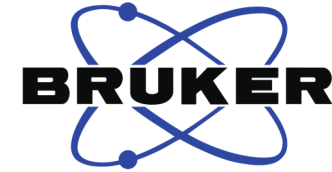

172.85
158.71
138.92
132.73
129.99
128.74
128.69
128.00
127.30
127.19
126.63
123.80
113.82
113.50
113.38
110.61
77.25
77.03
76.82
55.73
55.40
55.36
53.44
52.70
51.69
45.22
44.54
30.95
29.71

Current Data Parameters
NAME 6Sep1819
EXPNO 31
PROCNO 1

F2 - Acquisition Parameters
Date_ 20190918
Time 12.40 h
INSTRUM spect
PROBHD Z126545_0016 (
PULPROG deptqgppsp
TD 65536
SOLVENT CDC13
NS 256
DS 4
SWH 36057.691 Hz
FIDRES 1.100393 Hz
AQ 0.9087659 sec
RG 1440
DW 13.867 usec
DE 18.00 usec
TE 298.1 K
CNST2 145.0000000
D1 2.00000000 sec
D2 0.00344828 sec
D12 0.00002000 sec
D16 0.00020000 sec
TD0 1
SFO1 150.9480754 MHz
NUC1 13C
P1 10.00 usec
P13 2000.00 usec
PLW0 0 W
PLW1 66.00000000 W
SPNAM[5] Crp60comp.4
SPOALS 0.500
SPOFFS5 0 Hz
SPW5 10.08399963 W
SFO2 600.2524010 MHz
NUC2 1H
CNST12 1.5000000
CPDPRG[2] waltz16
P0 18.38 usec
P3 12.25 usec
P4 24.50 usec
PCPD2 70.00 usec
PLW2 25.60000038 W
PLW12 0.78399998 W
GPNAM[1] SMSQ10.100
GPZ1 31.00 %
GPNAM[2] SMSQ10.100
GPZ2 31.00 %
GPNAM[3] SMSQ10.100
GPZ3 31.00 %
P16 1000.00 usec

F2 - Processing parameters
SI 131072
SF 150.9329825 MHz
WDW EM
SSB 0
LB 1.00 Hz
GB 0
PC 1.40